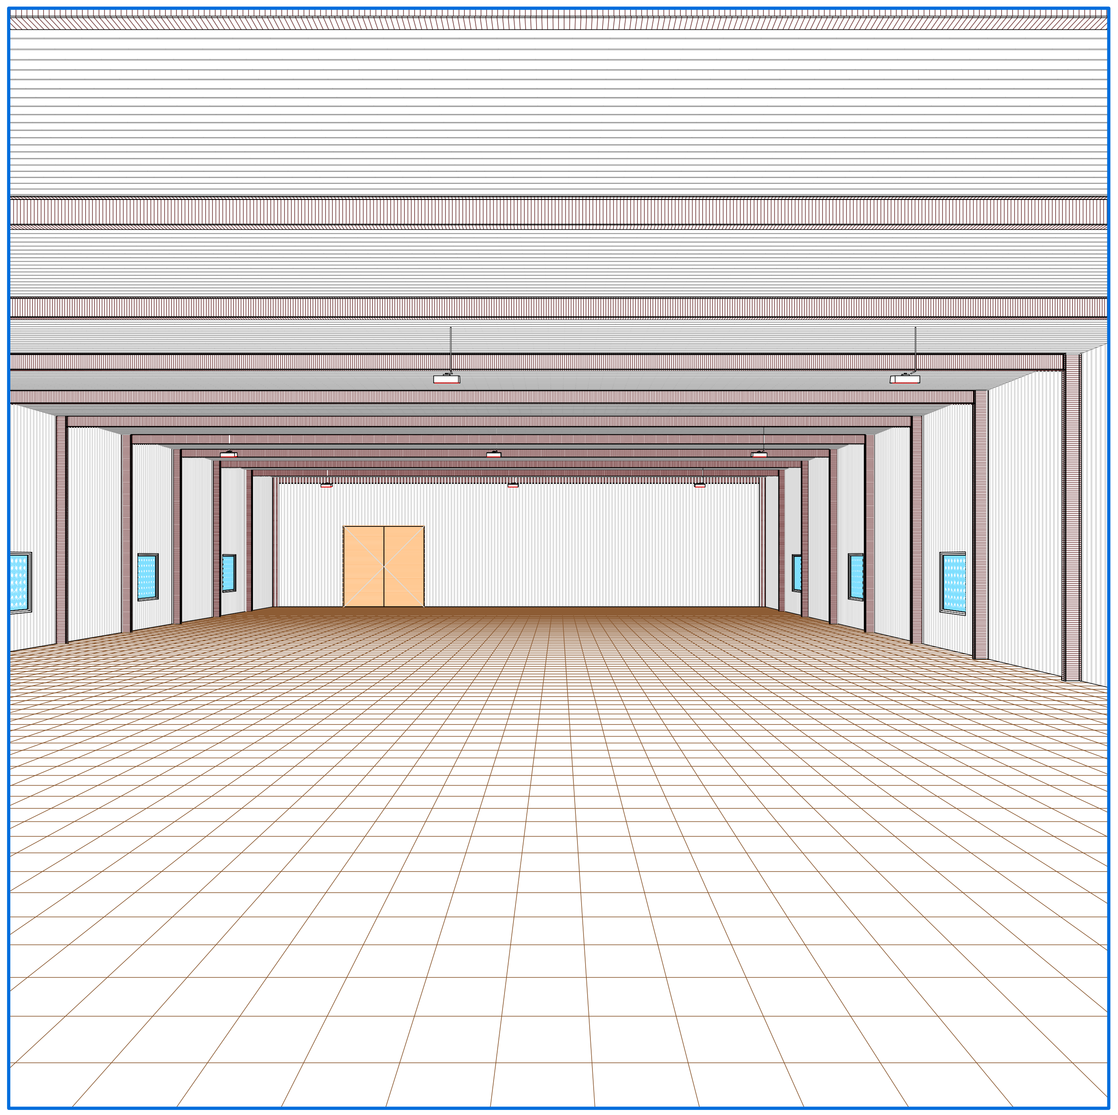

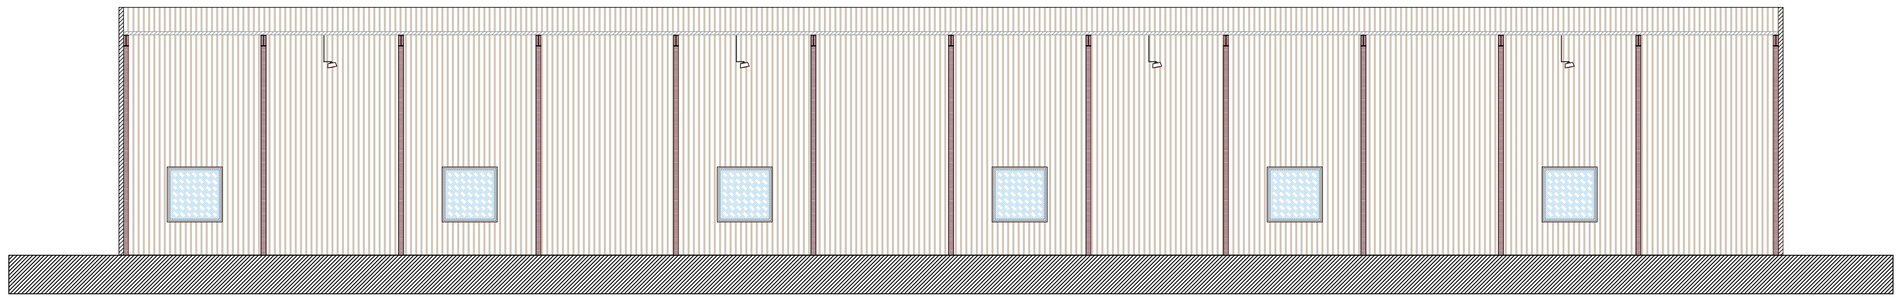

BB

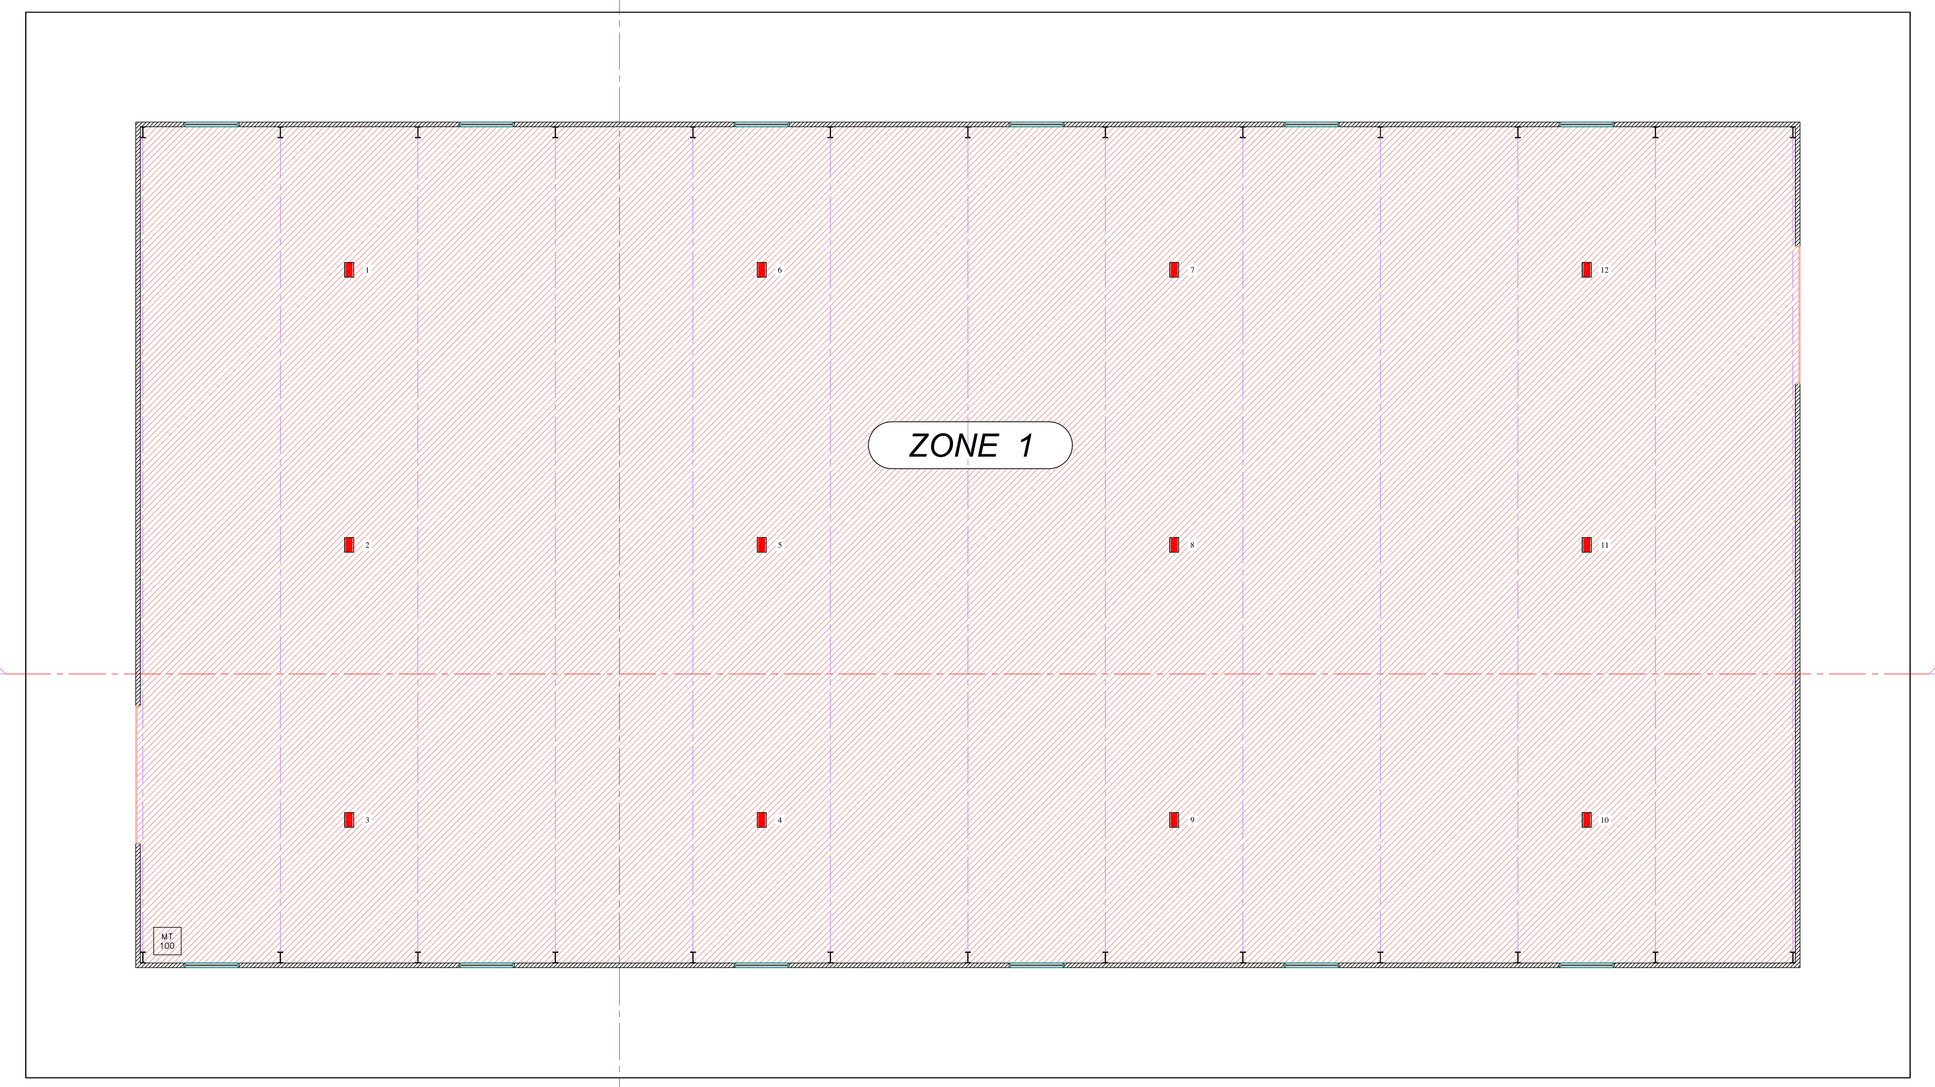

AA

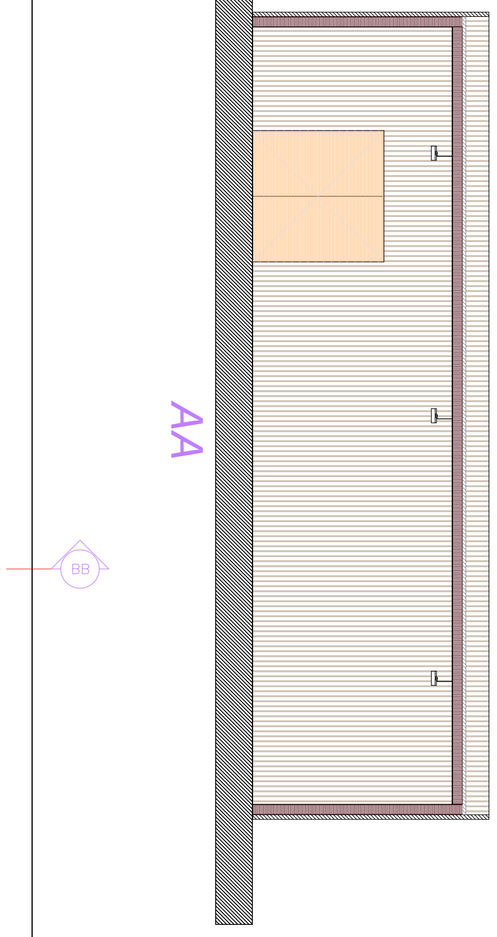

PRELIMINARY PROJECT

Zone 1

FOR THE PROPER OPERATION OF THE HEATING SYSTEM, ALLOW AIR RENEWAL RATE 10 m3 /h PER kW INSTALLED : 1 620 m3/h

EXAMPLE OF A BRACKET TO BE MANUFACTURED BY THE INSTALLER

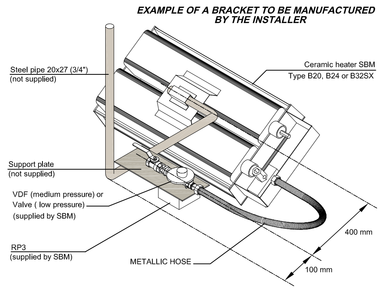

INSTALLATION OF CERAMIC HEATERS



B32SX from n° 1 to 12 h : 7,00 m i : 10"

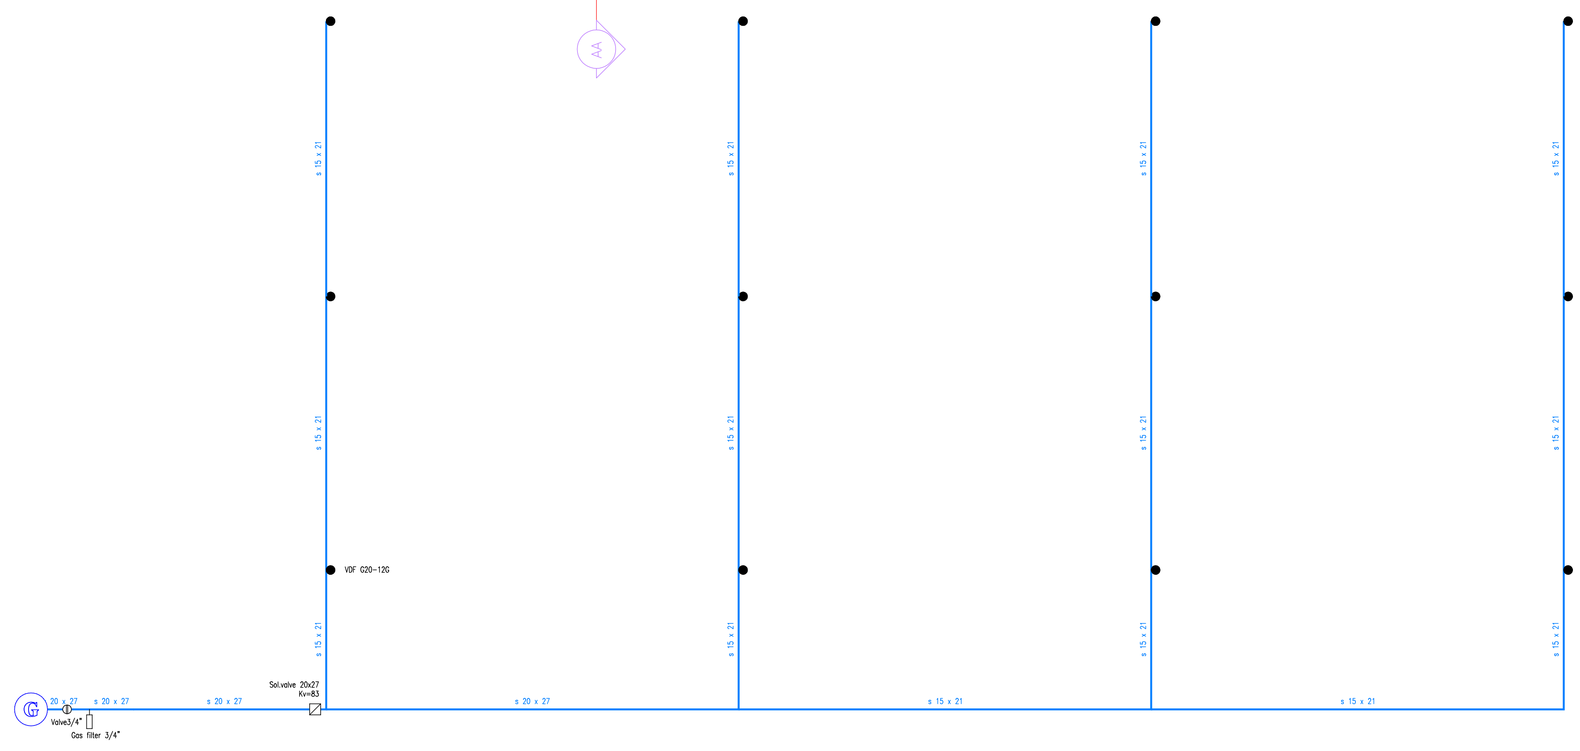

PAVLOGRAD-TEPLO

INDEX	DATE	REVISION

– THIS HEATING SYSTEM MUST BE INSTALLED IN ACCORDANCE WITH APPLICABLE RULES AND REGULATIONS, AND IN WELL VENTILATED PREMISES

SOCIETE
BOURGUIGNONNE DE
MECANIQUE

SBM 21490 CLENAY
TEL : (+33) 3.80.76.74.84
FAX : (+33) 3.80.76.74.89

SURVEY N° C18449

CBK BRICK

HEATING BY CERAMIC HEATERS WITH THERMOSTATIC REGULATION

TYPE OF GAS: G20

CAPACITY INSTALLED (Hi) : 162 kW

GAS INLET PRESSURE AT HEATER : 20 mbar

DELIVERY PRESSURE AT (G) POINT : 300 mbar

COMFORT TEMPERATURE : +14°C by –15°C (doors and openings closed)

POWER SUPPLY : 230V single phase

SCALE : 1/100 DATE : 1/04/2015 DRAWN BY : F. COLOMBAIN